





Handrails End Returns

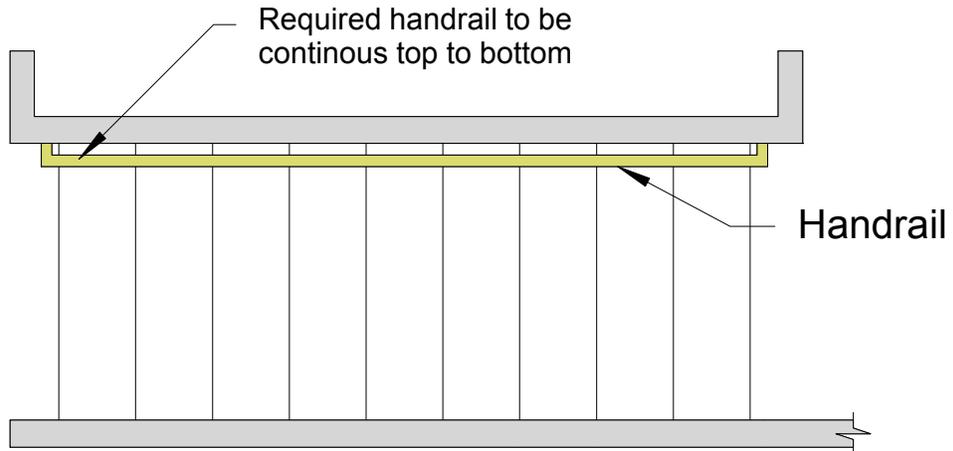

A clear space of 1 1/2 inches between handrails and abutting wall.
The ends of handrails are to be returned to the wall or floor

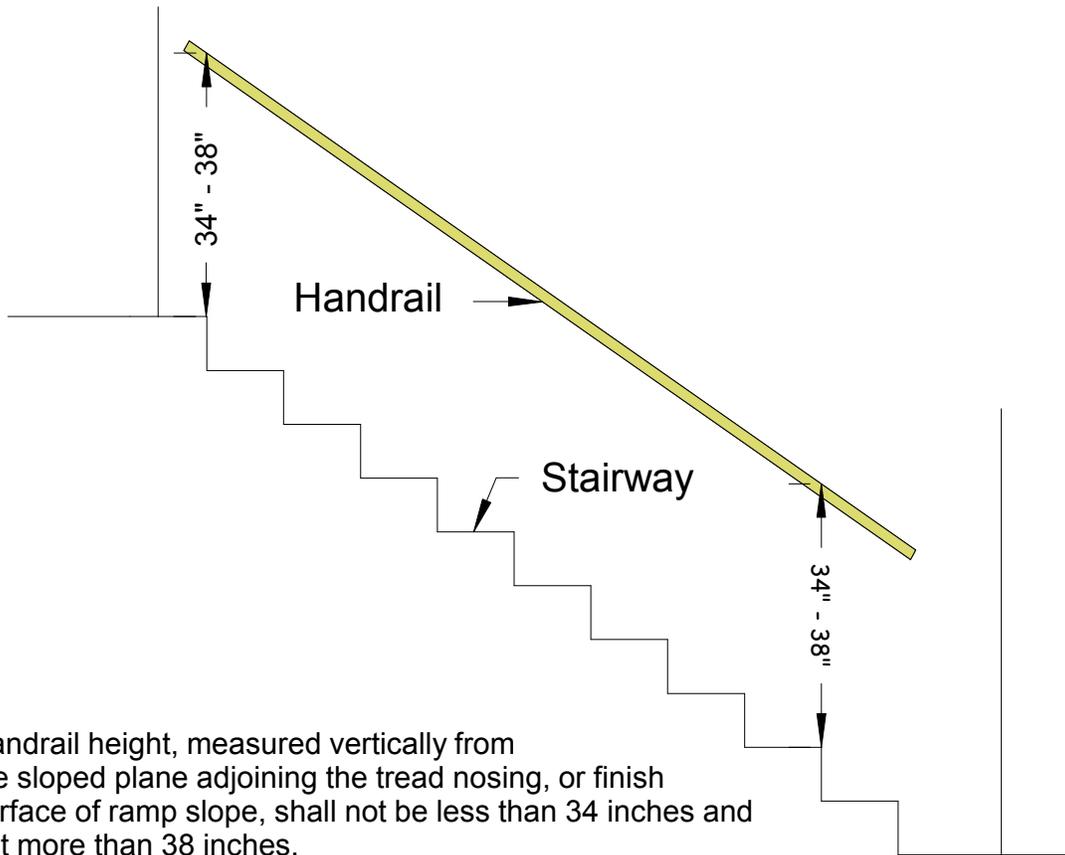

Handrail height, measured vertically from the sloped plane adjoining the tread nosing, or finish surface of ramp slope, shall not be less than 34 inches and not more than 38 inches.